


CO₂ Component Description

4" Stop (Directional) Valve

Effective: April 2002

K-81-5150

P/N: 890208

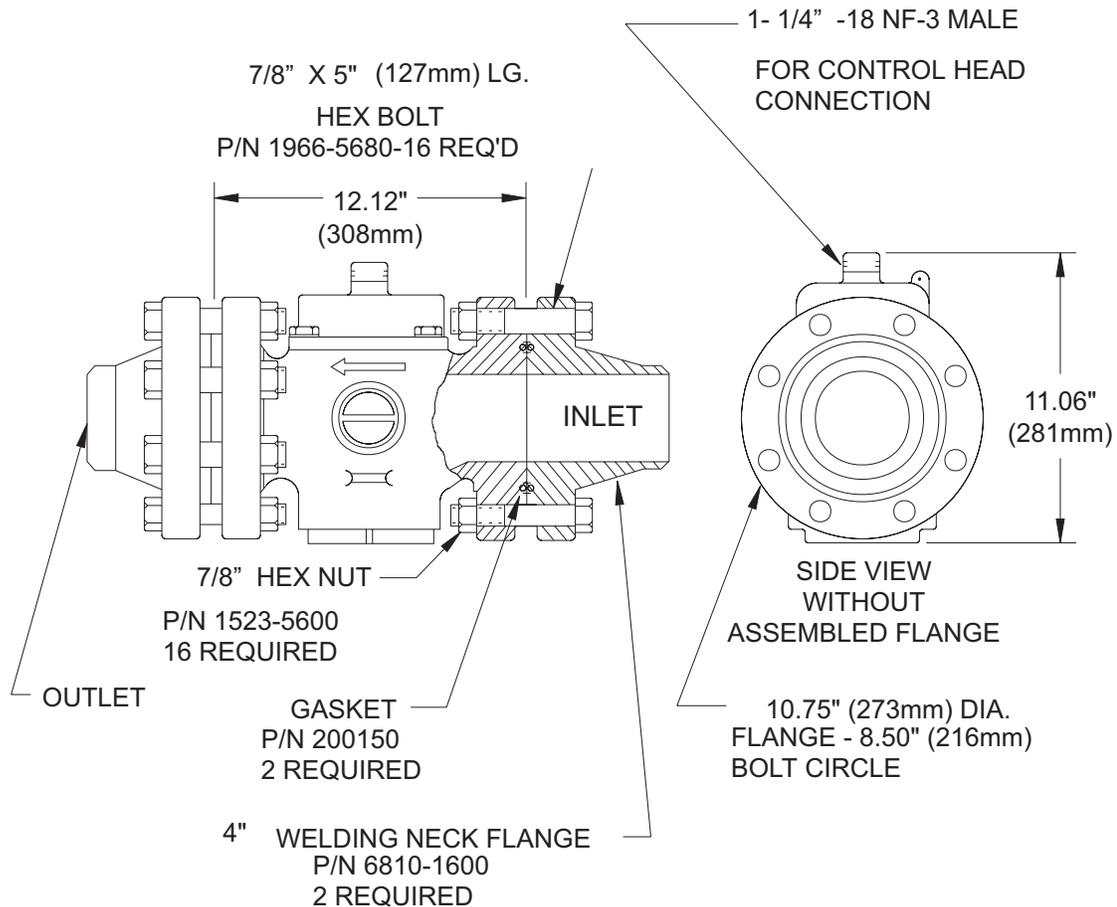

MATERIALS

VALVE BODY; BRASS

GASKET: IRON

FLANGES, BOLTS & NUTS: STEEL

VALVE MUST BE INSTALLED WITH ARROW POINTING IN
DIRECTION OF FLOW.

Operating Pressure (@ 70°F): 850 PSI (58 BAR)
Test Pressure: 2250 PSI (155 BAR)
Burst Pressure: 6000 PSI (413 BAR)

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL INC., Ashland, MA 01721. Telephone: (508) 881-2000

Kidde Fire Systems
400 Main Street
Ashland, MA 01721 USA
Tel: (508) 881-2000
Fax: (508) 881-8920
<http://www.kiddefiresystems.com>