

CO₂ Component Description


Type "I" Cylinder Valve, 1/2-in. With Typical Cylinder



A UTC Fire & Security Company

Effective: March 2011
K-81-1040

P/N: 981372

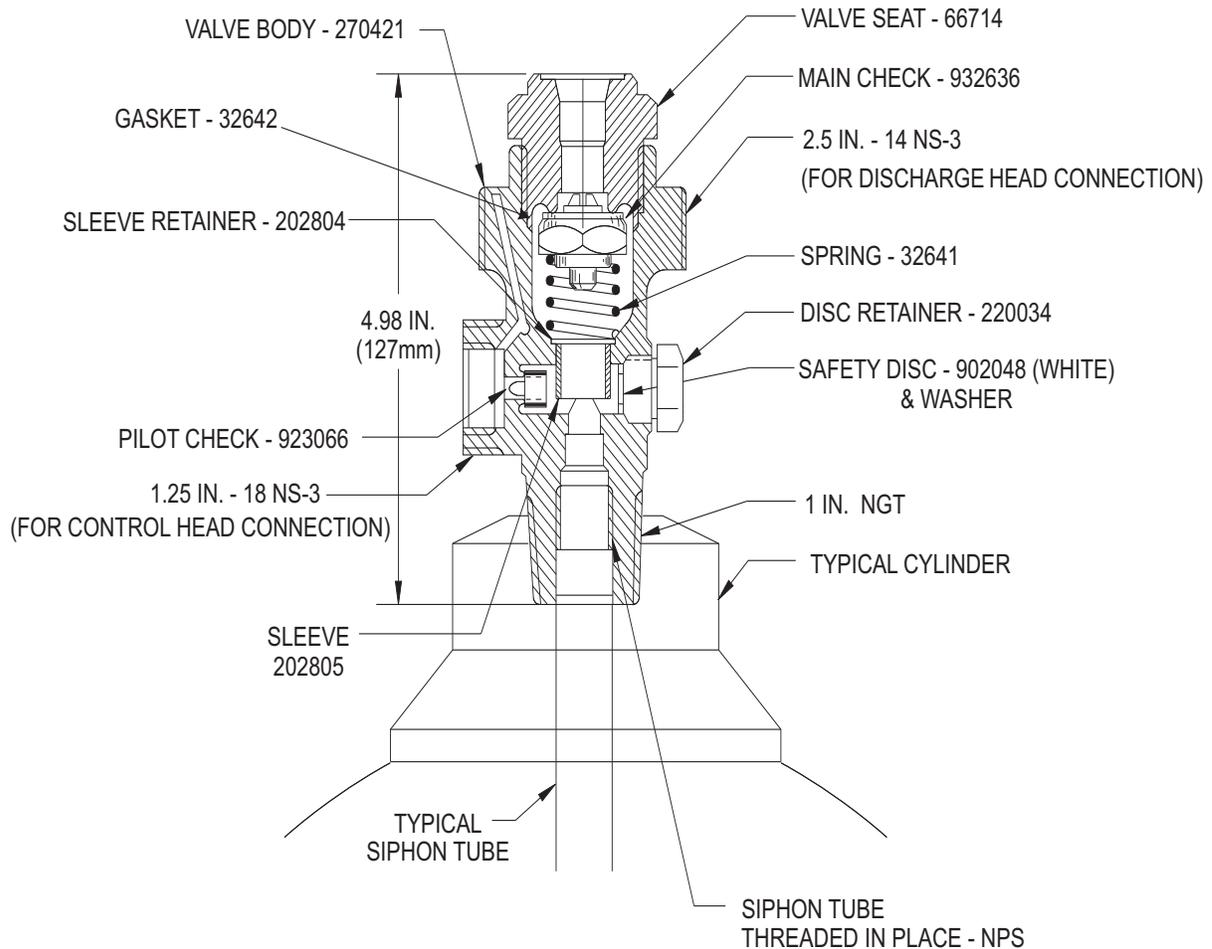

MATERIALS:

VALVE BODY:	BRASS
VALVE SEAT:	BRASS
SLEEVE:	BRASS
SLEEVE RETAINER:	BRASS
MAIN CHECK:	BRASS WITH RUBBER SEAT
PILOT CHECK:	STAINLESS STEEL WITH RUBBER SEAT

PRESSURE RATING:

WORKING = 2300 PSIG (158 BAR)
HYDROSTATIC = 6000 PSIG (413 BAR)

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com