

# FM-200<sup>®</sup> Component Description


## Cylinder Mounting Cradle



Effective: April 2007  
K-90-8150

### FEATURES

- For Use with UL Listed, ULC Listed and FM Approved Systems

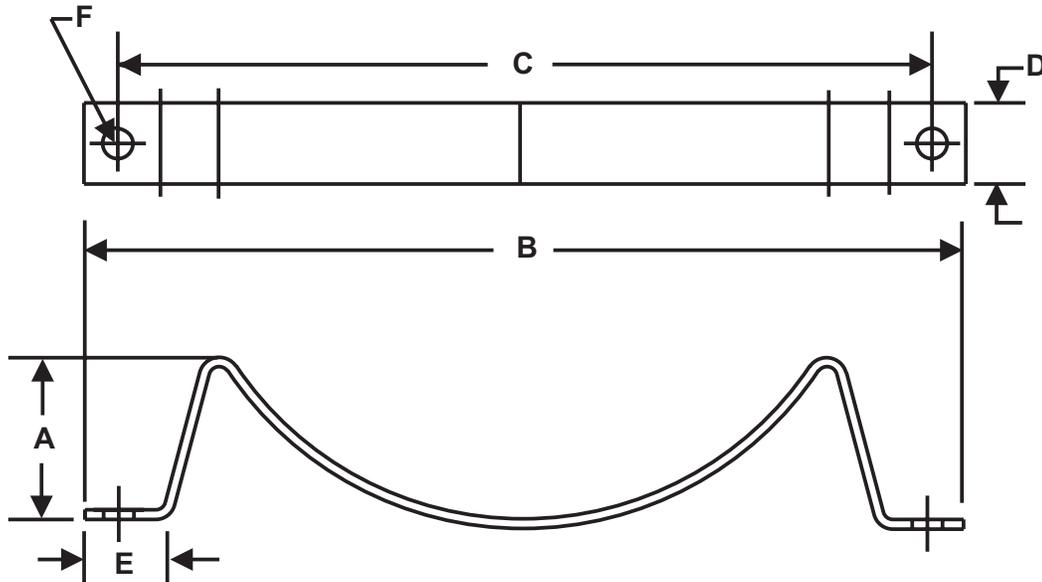

Dimensions – Cylinder Cradles

Part Number	Cylinder Capacity	Cylinder O.D.	A	B	C	D	E	F
235431	125, 200	12.75 in. (324 mm)	3.20 in. (81 mm)	16.25 in. (413 mm)	15.00 in. (381 mm)	1.50 in. (38 mm)	1.31 in. (33 mm)	0.56 in. (14 mm)
281867	350	16.00 in. (406 mm)	3.58 in. (91 mm)	19.24 in. (489 mm)	18.00 in. (457 mm)	1.50 in. (38 mm)	1.34 in. (34 mm)	0.56 in. (14 mm)
294652	600	22.00 in. (559 mm)	4.75 in. (121 mm)	25.24 in. (641 mm)	24.00 in. (610 mm)	1.75 in. (45 mm)	1.340 in. (34 mm)	0.56 in. (14 mm)
06-118300-001	900	24.00 in. (610 mm)	5.18 in. (132 mm)	27.74 in. (705 mm)	26.00 in. (660 mm)	1.75 in. (45 mm)	1.68 in. (43 mm)	0.63 in. (16 mm)

### MATERIALS

- Steel, zinc chromate primer gray (AISI M1020) and black lacquer

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)